

James Nykaza
Chief Fire Marshal




Steve Forbes
Deputy Fire Marshal

City of Humble Fire Marshal's Office

110 W. Main Street, Humble, Texas, 77338
281-446-4928

FIRE DEPARTMENT CONNECTION (FDC) SIGN DESIGN REQUIREMENTS

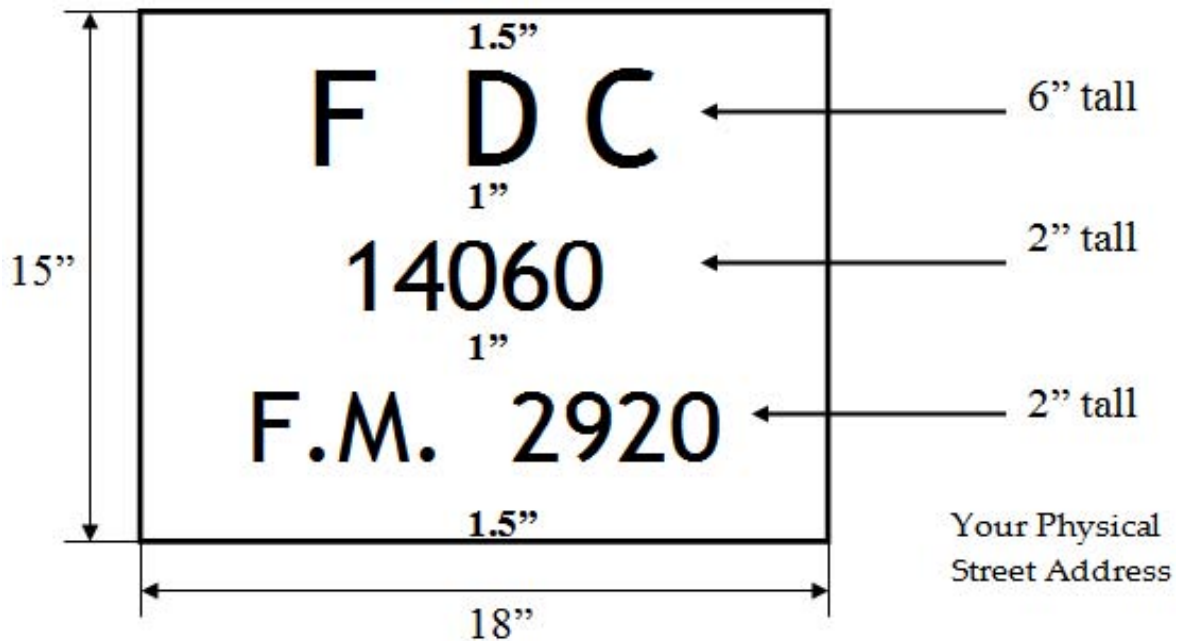

1. Sign must be constructed from a 15" high by 18" wide metal substrate no thinner than .063 in.
2. Sign must have square corners.
3. Background color of the sign must be "Fire Engine Red" non-reflective.
4. White reflective letters must be used as set out below.
5. Letter must be a font comparable to "Folio medium" or "Helvetica medium".
6. Sign must be permanently attached to a wall directly above fire department connection (FDC) or below freestanding FDC. It must be 72" from the ground to the bottom of the sign, unless otherwise approved by Fire Marshal.
7. First line (FDC) must be 6" high letters with 3" between each letter.
8. Second and third lines must be 2" high with 1/2" spacing between letters.
9. There must be a 1" margin completely around sign and 1" spacing between lines of text.
10. There must be 2" spacing between complete words.
11. Second and third line must have address of building that system provides for.